

Project Owner:	Battle Creek Public Schools
Project Name:	Northwestern Middle School Technology Improvements
Issue Date:	April 13, 2023

ADDENDUM NO. 1

This Addendum No. 1 of the Technology Request for Bid for the above referenced project hereby amends, supplements and/or augments all prior issued document(s) as described herein, and becomes an inseparable part of the Contract Documents, superseding all previous, contrary and/or conflicting information.

AD1 - 1	Section 27 10 00.2.06.A is hereby revised as follows: A. See Drawing T0.01 - Communications Drawings for cabling locations and quantity.
AD1 - 2	Appendix C: PA System Drawing is hereby revised, reissued and attached hereto.


END OF ADDENDUM NO. 1

<i>Bid ID: 3009</i>	Communications by Design, Inc.
<i>Questions and Answers Issued: April 21, 2023</i>	<i>Proprietary Information – All Rights Reserved</i>

SYMBOL LEGEND	
	EXISTING DATA DROP (COUNT)
	EXISTING PROJECTION
	EXISTING PROJECTION DATA DROP
	EXISTING PROJECTION SCREEN
	EXISTING CLOCK
	EXISTING PUBLIC ADDRESS SPEAKER - DOUBLE SIDED
	EXISTING PUBLIC ADDRESS HORN
	EXISTING CLASSROOM SOUND SPEAKER
	EXISTING WIRELESS ACCESS POINT
	NEW DATA DROP WALL
	NEW DATA DROP CEILING COUNT, CABLE COILED IN CEILING
	NEW CLOCK - SINGLE SIDED
	NEW CLOCK - DOUBLE SIDED
	NEW PROJECTOR
	NEW PROJECTOR TEACHER STATION
	NEW PROJECTION SCREEN
	NEW CLASSROOM SOUND SPEAKER
	NEW PUBLIC ADDRESS SPEAKER CEILING (2X2)
	NEW PUBLIC ADDRESS HORN
	NEW CALL PUBLIC ADDRESS CALL BUTTON
	NEW STROBE LIGHT

SYMBOL LEGEND CONTINUED	
	DOOR NUMBER
	EXISTING ACCESS CONTROL PANEL
	EXISTING CARD READER
	EXISTING ELECTRIC STRIKE - SURFACE MOUNT
	EXISTING ELECTRIC STRIKE
	EXISTING MAG LOCK
	EXISTING DOOR CONTACT
	NEW CARD READER
	NEW ELECTRIC STRIKE - SURFACE MOUNT
	NEW ELECTRIC STRIKE
	NEW MAG LOCK
	NEW DOOR CONTACT
	NEW MOTION REQUEST TO EXIT MOTION SENSOR
	NEW DOOR RELEASE BUTTON
	NEW LOCKDOWN BUTTON
	NEW IP DOOR INTERCOM - DOOR STATION - EXTERIOR
	NEW IP DOOR INTERCOM - MASTER STATION - INTERIOR
	NEW PUSH TO ENTER BUTTON

APPENDIX C - PUBLIC ADDRESS DRAWING ADDENDUM 1

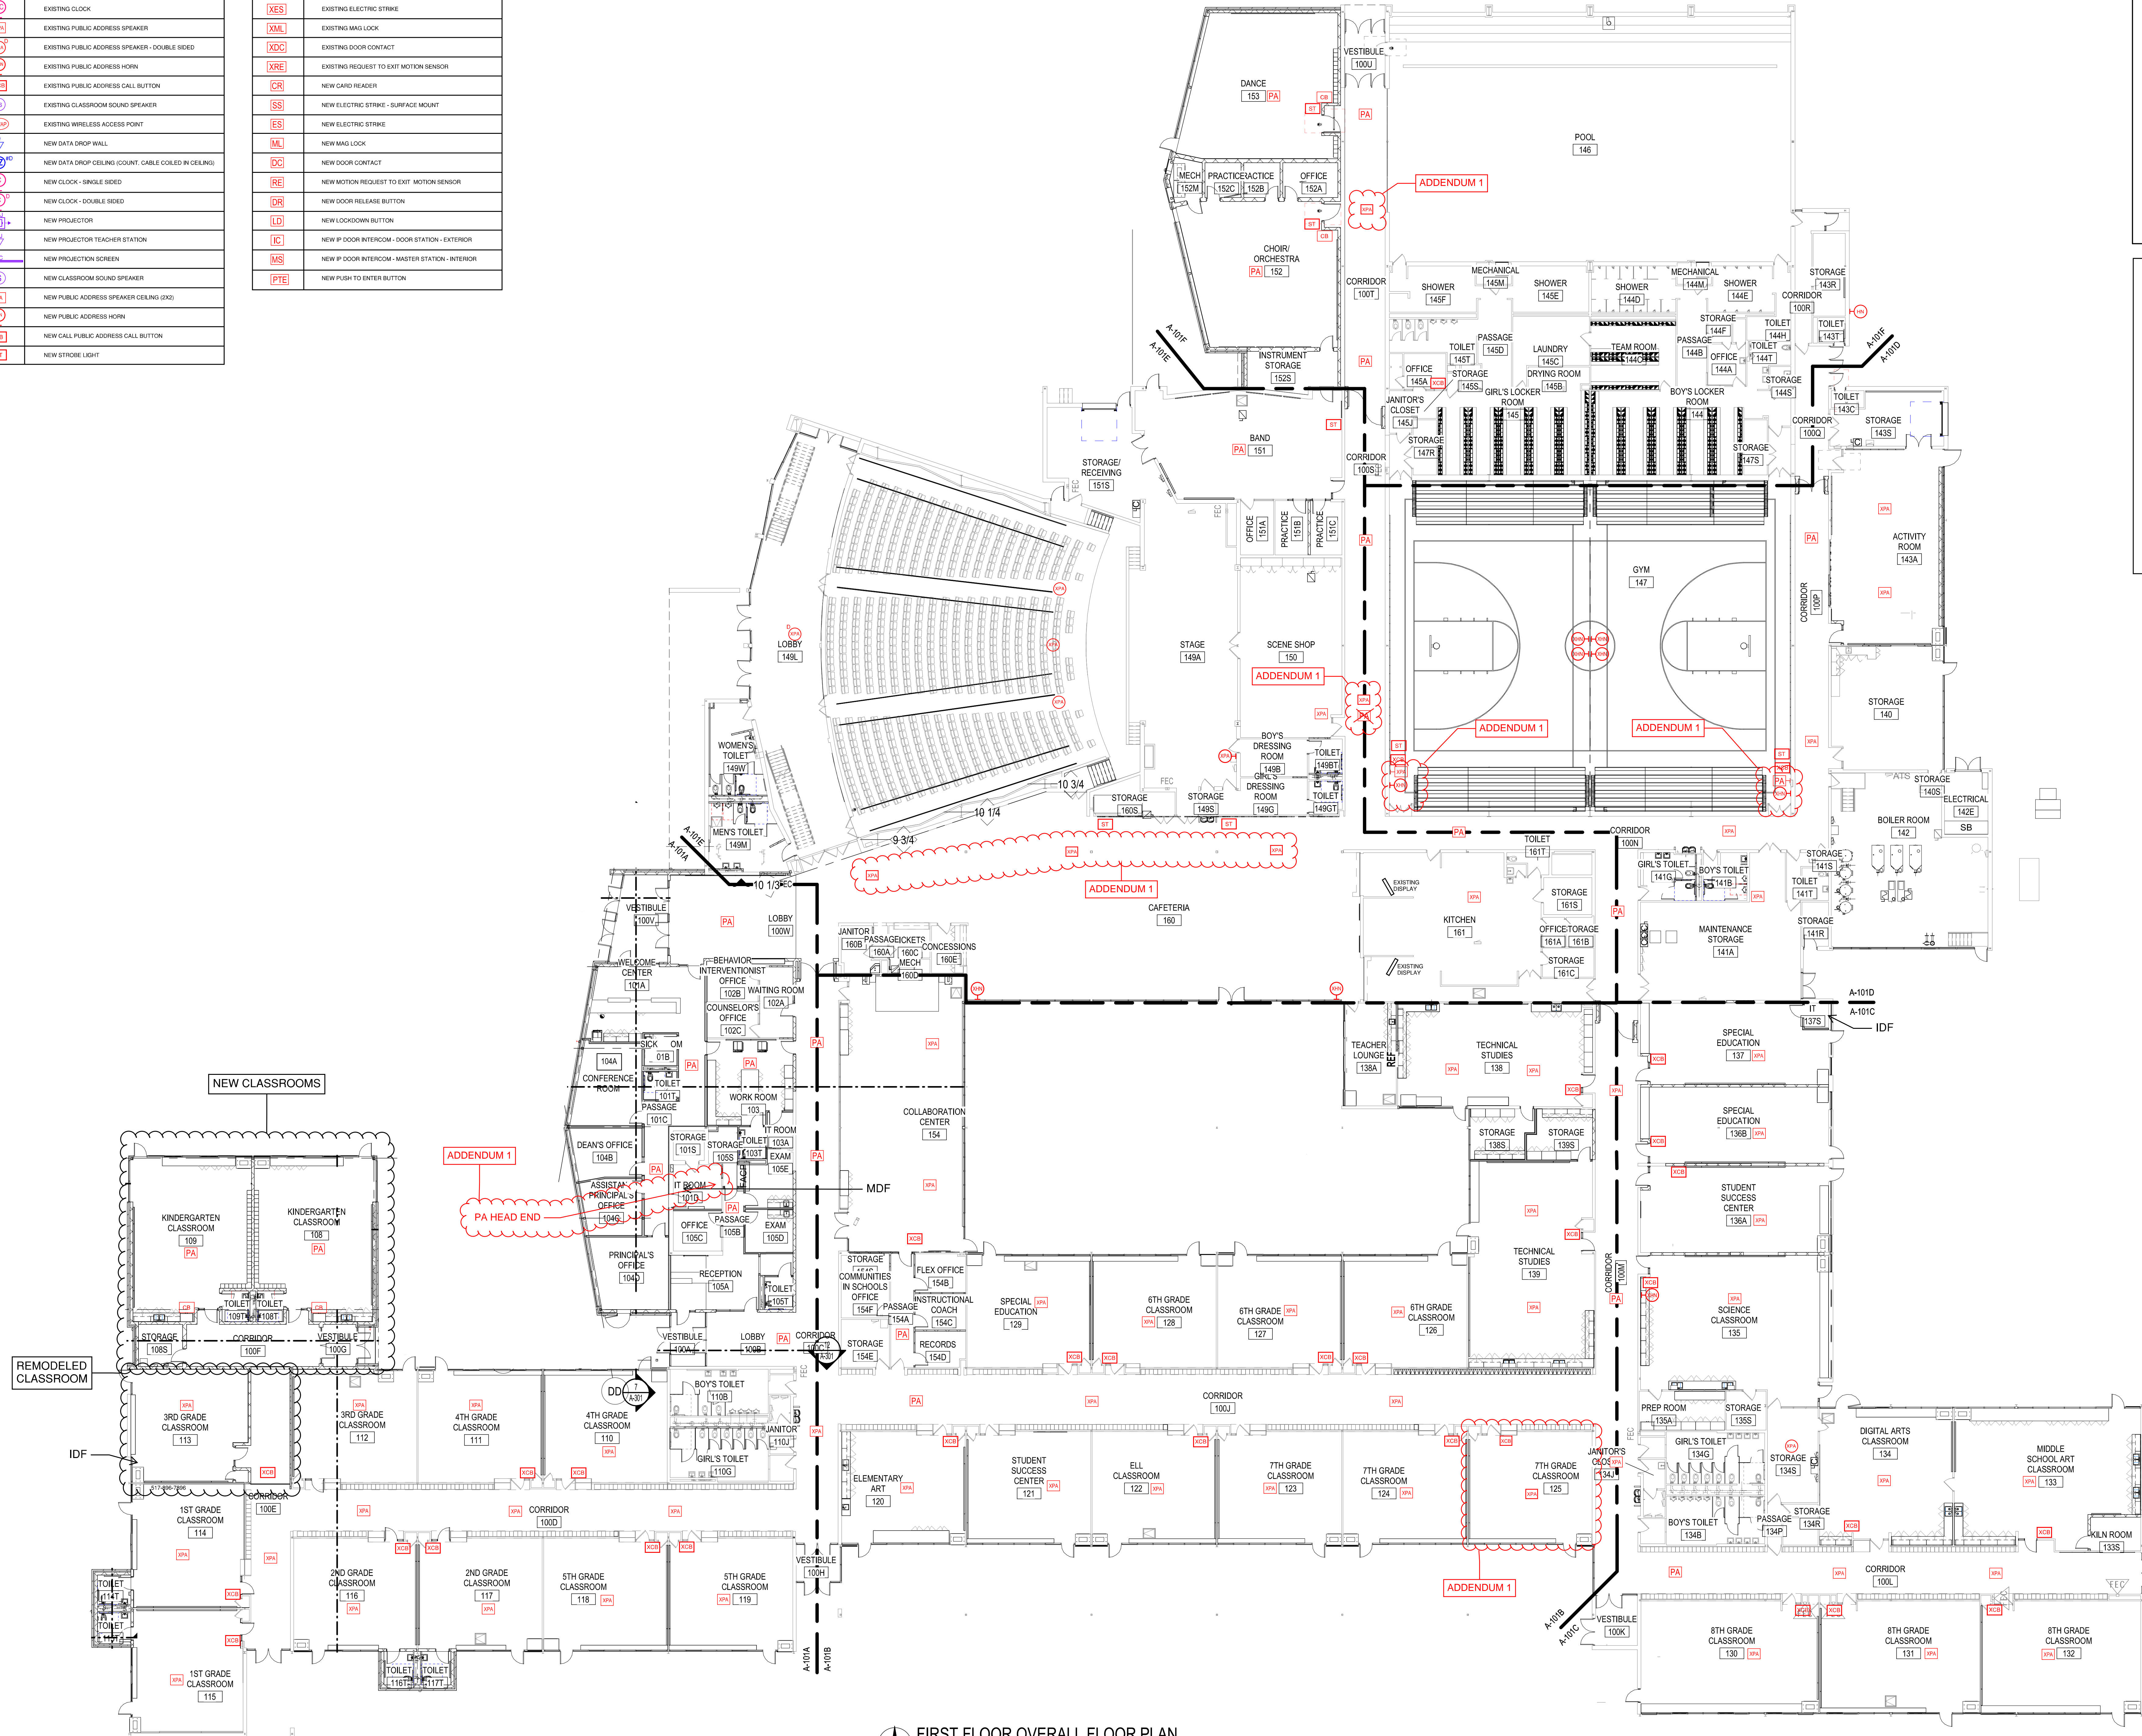

FIRST FLOOR OVERALL FLOOR PLAN
1/16" = 1'-0"

- GENERAL NOTES:**
- SUB-CONTRACTORS ARE TO COORDINATE WORK WITH ALL OTHER TRADES.
 - CONFLICTS BETWEEN NOTES, DETAILS, SPECIFICATIONS, ETC., SHALL BE VERIFIED WITH THE OWNER'S REPRESENTATIVE OR THE MOST STRINGENT PROVISIONS SHALL GOVERN.
 - DETAILS OF CONSTRUCTION NOT FULLY SHOWN SHALL BE OF THE SAME NATURE AS SHOWN FOR SIMILAR CONDITIONS. ANY UNCLEAR CONDITIONS SHALL BE VERIFIED WITH OWNER'S REPRESENTATIVE PRIOR TO CONSTRUCTION OF THAT AREA.
 - DRAWINGS ARE NOT TO BE SCALED. ANY UNCLEAR DIMENSIONS OR DIMENSIONAL DISCREPANCIES SHALL BE VERIFIED WITH OWNER'S REPRESENTATIVE.
 - ALL EXISTING CONDITIONS AND ALL RELATED DIMENSIONS INDICATED IN THE CONTRACT DOCUMENTS SHALL BE FIELD VERIFIED PRIOR TO FABRICATION, ERECTION, AND/OR CONSTRUCTION. ANY CONDITIONS THAT DIFFER FROM THAT INDICATED IN THE CONTRACT DOCUMENTS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE FOR REVIEW PRIOR TO FABRICATION, ERECTION, AND/OR CONSTRUCTION.
 - CONSTRUCTION MANAGER (CM) / GENERAL CONTRACTOR (GC) TO REVIEW ENTIRE SET OF CONSTRUCTION DOCUMENTS AND SHALL COORDINATE WORK BETWEEN ALL TRADES. IF CONFLICTS ARISE DUE TO COORDINATION OF TRADES, CM / GC IS TO VERIFY CONFLICT WITH OWNER'S REPRESENTATIVE PRIOR TO CONSTRUCTION / INSTALLATION OF CONFLICTING ITEMS.
 - PATCH ALL EXPOSED INTERIOR AND EXTERIOR WALLS WHERE ATTACHED OR MISSED ITEMS WERE REMOVED.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PREPARATION OF ALL SURFACES AS REQUIRED TO RECEIVE NEW FINISHES.
 - ALL DIMENSIONS ARE FROM FACE OF STUD, C.M.U., OR CONCRETE, U.N.O.
 - PROVIDE ISOLATION MATERIAL BETWEEN DISSIMILAR MATERIALS THAT ARE IN CONTACT WITH ONE ANOTHER.
 - PATCH & REPAIR ALL MAJOR & MINOR BLEMISHES AS REQD. DUE TO DEMOLITION WORK. MATCH ADJACENT MATERIAL & COLOR.
- TECHNOLOGY NOTES:**
- 27 10 00 Contractor to provide data CAT6 data cabling for all locations located on the walls as indicated on drawings.
 - Data cabling in center of classrooms indicated as SD shall be four (4) CAT6 data cables and one (1) CAT6A data cable for future Access Point.
 - All data cabling shall be plenum rated.
 - 27 41 16 Contractor shall install equipment listed per specification in the new classroom addition.
 - Existing classroom and remodeled classroom audio visual equipment and projection screens will be removed by other and reinstalled by the same contractor.
 - 27 41 16 Contractor shall supply and install projection and screen per specification for Dance, Choir and Band Room. See Appendix H. Coordinate wall stations with construction division 28 contractor.
 - 27 51 16 Contractor shall remove existing public address speakers and reinstall according to construction phasing plan.
 - 27 51 16 Contractor to remove all head end equipment located in the MDF and replace with a new system. New system shall integrate existing and new speakers.
 - 27 53 13 Contractor shall remove of and dispose of all existing clocks and associated cabling to source. Contractor to install new clock system head end in MDF. All demolished clocks are to be replaced with new clocks as part of this contractors scope. Contractor to supply all necessary cabling for new clock system.
 - 28 13 00 Contractor to reference Appendix H for Door Hardware Schedule.